NOTES:
1) IN LIEU OF BELLS, PROVIDE MECH. JOINTS WHERE D.I. PIPE IS SPECIFIED.
2) FOR POURED BASE REINFORCEMENT REFER TO DETAIL #SN604.



SECTION C-C

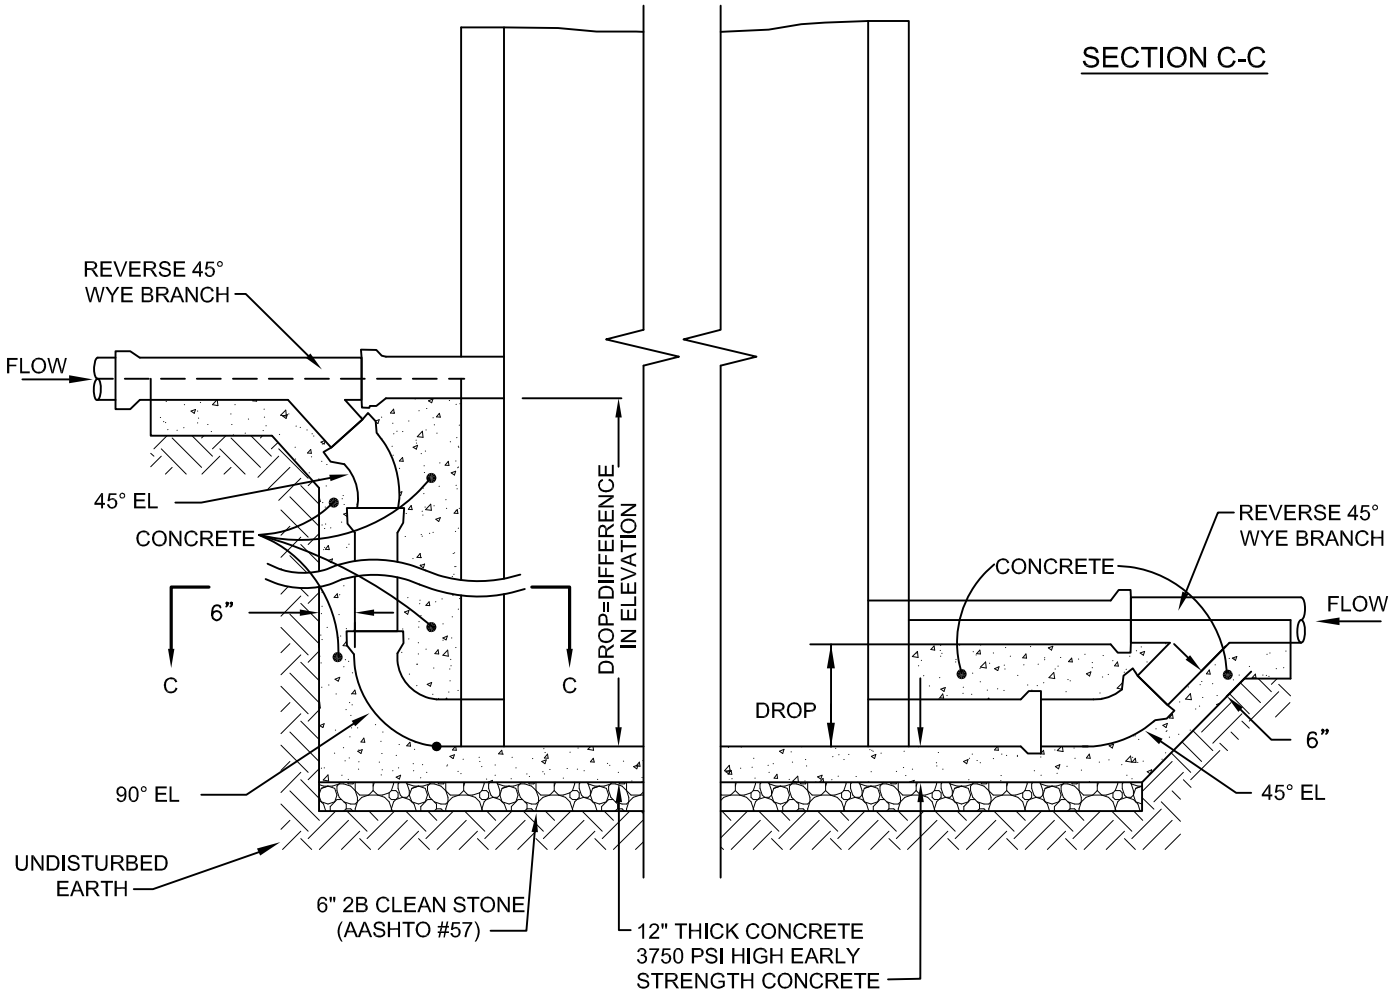

TYPE A

TYPE B

TYPE B DROP
MAX. DROP

8" SEWER 3'-6"
10" SEWER 3'-9"
12" SEWER 4'-6"
15" SEWER 4'-6"

FRANCONIA TOWNSHIP STANDARD DETAIL

DROP MANHOLE

DATE	7–2012	NOT TO SCALE	SN605

Metz Engineers

SN605.DWG