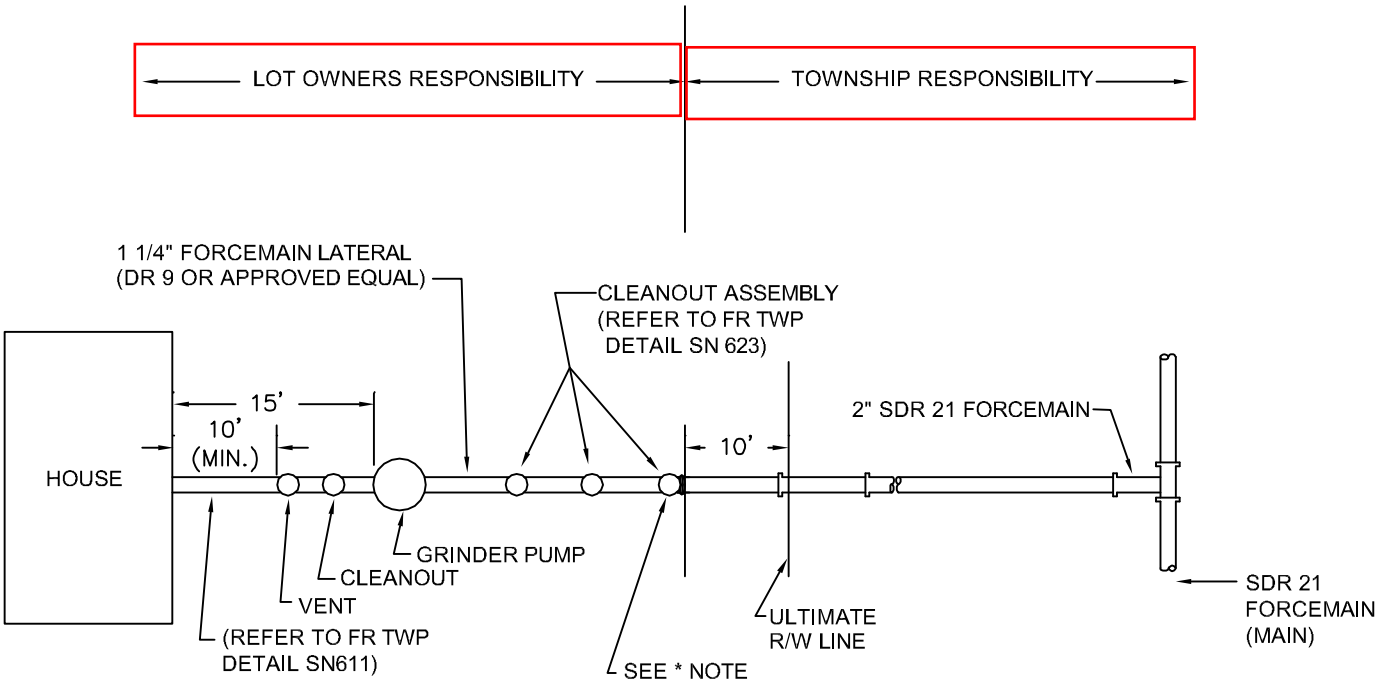

* NOTE: THE FIRST VALVE IS TO BE INSTALLED ALONG WITH FORCEMAIN (MAIN) A THRUST BLOCK WILL NEED TO BE PLACED BEHIND THIS VALVE. VALVE WILL NEED TO BE SHUT OFF UNTIL BUILDING/ HOUSE IS TIED INTO SYSTEM. THE REMAINDER OF THE CLEANOUT ASSEMBLY IS TO BE SUPPLIED AND INSTALLED BY THE PLUMBER INSTALLING THE PRESSURE LATERAL TO THE GRINDER PUMP. MAINTENANCE OF THE LATERAL BELONGS TO THE LOT BEING SERVICED, BEGINNING AT THE FIRST VALVE.

FRANCONIA TOWNSHIP STANDARD DETAIL

TYPICAL PLAN VIEW OF BUILDING/HOUSE WITH GRINDER PUMP

DATE	2-2015	NOT TO SCALE	SN629

Metz Engineers